

MSG particulate mg/MJ in	-----organics-----				Delivered efficiency	MSG particulate mg/MJ out	-----organics-----			
	grav,mg/MJ in	too,mg/MJ in	pah,mg/MJ in	too,mg/MJ out			grav,mg/MJ out	too,mg/MJ out	pah,mg/MJ out	too,mg/MJ out
452	321	20.3	7.00	58.9	768	544	34.4	11.9		
674	380	80.1	5.88	58.2	1158	652	137.6	10.1		
1304	823	34.2	25.5	38.8	3358	2121	88.0	65.8		
792	546	36.8	11.6	53.4	1483	1022	69.0	21.6		
849	597	183	13.1	46.4	1830	1286	394.9	28.2		
923	632	85.9	12.2	42.4	2174	1489	202.5	28.7		
607	234	301	29.1	47.6	1276	492	632.5	61.3		
810	1170	917	57.4	54.4	1489	2151	1686	105.6		
581	370	61.0	17.5	50.5	1149	732	120.8	34.6		
708	407	102	16.8	57.1	1240	712	177.8	29.4		
502	329	106	12.5	55.4	905	595	189.4	22.5		
492	319	74.1	17.7	55.1	893	579	134.5	32.1		
724	515	148	18.8	51.5	1406	1000	288.0	36.5		
801.27	587.69	207.29	20.23	50.01	1892.10	1219.70	405.63	41.65		
570.64	356.35	85.42	16.11	54.55	1046.73	654.50	155.63	29.65		

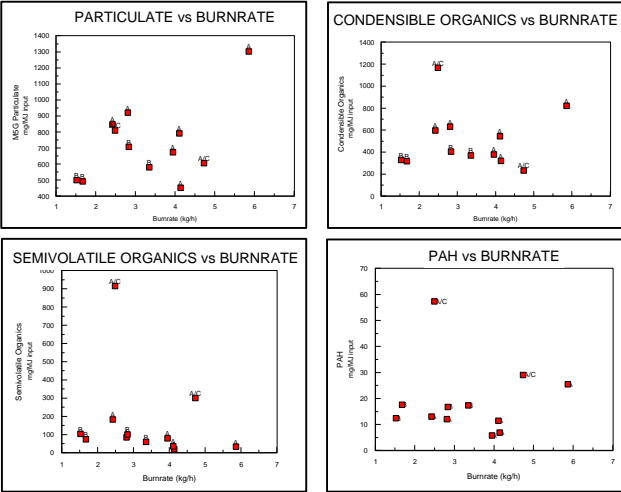


Figure 4-1. Summary of particulate and organic emissions data for wood-fired furnaces A and B.

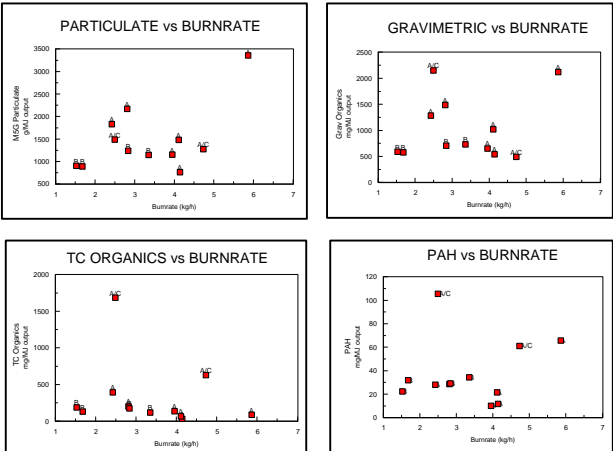


Figure 4-1. Summary of particulate and organic emissions data for wood-fired furnaces A and B.